



# CSIRO ACOUSTIC MEASUREMENT REPORT

Commonwealth Scientific and Industrial Research Organisation, Infrastructure Technologies  
Acoustics Testing Laboratory, Research Way, Clayton, Vic 3168 Australia

Report No:  
**AC316-05-1**

**Client:** Woven Image Pty. Ltd.  
37-39 Chard Road, Brookvale, NSW 2100 Australia

## Measurement Type: Sound Absorption

AS ISO 354-2006 [R2016]: *Acoustics-Measurement of sound absorption in a reverberation room*  
AS ISO 11654-2002 [R2016] (ISO 11654:1997): *Acoustics-Rating of sound absorption-Materials and systems*

### Test Specimen [Specimen area: 3.410 x 3.010 m (10.264 m<sup>2</sup>)]

**Description:** Woven Image 'Embossed IV' panel,  
installed with a 20 mm air gap from the room surface.

#### Woven Image Embossed IV Details<sup>3</sup>

- Product designation: Embossed IV panel
- Embossed IV composition: 9 mm thick 100% PET (51% recycled) composite panel of Mura™ face laminated to Epsilon and embellished with compressed surface pattern (pattern repeating at 25 mm intervals varying thickness from 7 mm to 9 mm – see lower image at right), compressed polyester fibre composition (non-woven), 5° backwards bevel straight cut edges on all four sides.
- Physical characteristics: Supplied for testing as panels of dimension 2800 mm (±2 mm) x 1130 mm (±2 mm) x 9 mm (±7%), Weight (meas.): 2570 g/m<sup>2</sup>

#### Installation

- The reverberation chamber was swept and vacuumed.
- The test specimen was installed on randomly orientated 20 mm high timber spacers to support the panels with a uniform 20 mm air gap between the underside of the panel under test and the floor of the test chamber.
- The specimen for testing consisted of 3 complete panels and 3 segments cut to 200 x 1130 mm arranged in a rectangle 3.410 x 3.010 m, at an angle of 11° from the nearest chamber wall (not parallel, as per AS ISO 354 cl 6.2.1.2).
- The perimeter edges of the test specimen were covered with a skirt of 1 mm thick folded steel angle, 30 mm high. Skirting members were pushed against the edges of the panels; pushing the panels against each other and minimising gaps at the skirt. Gaps between the skirting members and the surrounding chamber floor were sealed with tape.
- Specimen installation was carried out by laboratory staff.




Test specimen installed in laboratory for testing



Detail of side and front of Panel.

## Measurement Details & Results

Freq Hz	Absorption coefficients			Reverberation times, T <sub>60</sub> (sec)	
	α <sub>s</sub>	α <sub>p</sub>	95% Conf	Empty room	with Specimen
100	0.01		0.04	5.09	5.02
125	0.03	0.00	0.04	5.92	5.63
160	0.04		0.03	6.53	6.03
200	0.07		0.04	6.07	5.34
250	0.10	0.10	0.05	4.74	4.09
315	0.18		0.03	5.91	4.44
400	0.22		0.04	5.72	4.10
500	0.33	0.35	0.03	5.46	3.45
630	0.49		0.04	5.25	2.90
800	0.62		0.04	5.00	2.52
1000	0.73	0.70	0.04	4.80	2.27
1250	0.79		0.03	4.32	2.07
1600	0.87		0.04	3.92	1.88
2000	0.92	0.90	0.04	3.56	1.74
2500	0.97		0.03	3.17	1.60
3150	0.94		0.03	2.81	1.53
4000	0.96	0.95	0.04	2.33	1.36
5000	0.90		0.05	1.90	1.23

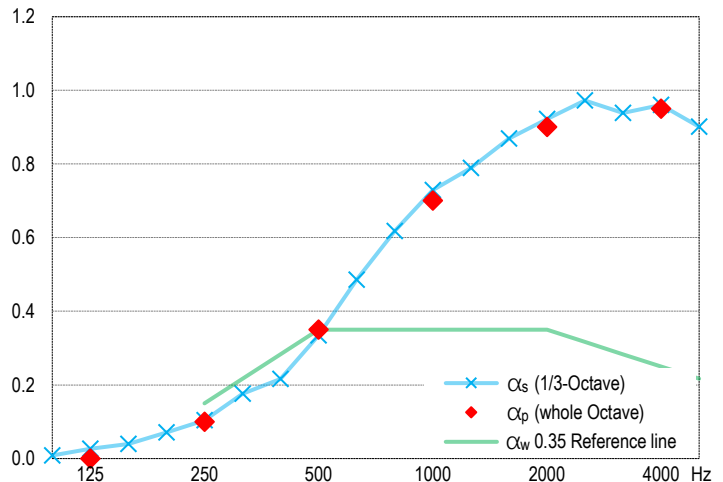

### Performance Indices<sup>1,2</sup>

α<sub>w</sub> = 0.35 (MH)

SAA = 0.52

NRC = 0.50

Sound Absorption Class = D

The required 12 spatially independent decay curves came from ensemble averaging 10 successive decays with each of 3 different source loudspeaker positions, all sampled by 4 fixed microphones, using linear averaging.


### Measurement Conditions

	Empty room	with Test Specimen
Date of measurement:	8 Feb 2022	8 Feb 2022
Temperature & humidity:	23 °C, 46 % R.H.	24 °C, 45 % R.H.
Atmospheric pressure:	1003 mBar	1002 mBar

## Notes, Deviations etc

1. Shape indicators (L, M, and H), if any, following the α<sub>w</sub> index, indicate α<sub>p</sub> values above the reference contour by ≥ 0.25 in the Low, Medium or High frequency ranges respectively; it is strongly recommended to use this single number rating in combination with the complete sound absorption coefficient curve.
2. SAA and NRC are defined in ASTM C423; laboratory requirements for which differ from AS ISO 354.
3. Physical characteristics of materials may be as per client or supplier's advice; not necessarily verified by CSIRO.

## Issuing Authority

Signed:   
Date: 24 February 2022

## Instrumentation

Real time analyser: • Brüel & Kjær PULSE LAN-XI type 3160-A-4/2  
Microphones/preamps: • 4 microphones (1 x B&K 4134, 1 x B&K 4166, and 2 x GRAS 40AR) on B&K and GRAS preamps, in fixed positions as per AS ISO 354  
Noise source: • Room populated with three Norsonic NOR276 dodecahedron loudspeakers, driven in turn by a Norsonic NOR280 power amplifier.  
Calibration: • Analyser: September 2021 (NATA cal)

## Laboratory Construction

Reverb room: • 300 mm thick concrete (closed off from the adjoining room by a plaster-board wall) • parallelepiped with dimensional proportions 1:1.3:1.6 for distribution of room modes • approx. 202 m<sup>3</sup> total room volume  
• approx. 215 m<sup>2</sup> surface area excluding diffusers  
Diffusers: • 20 stationary diffusers, approx. 40 m<sup>2</sup> total surface area  
Absorption area: • in accordance with AS ISO 354, unless noted otherwise