

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499

TEST REPORT

Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100

Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016

Sample Description Clients Ref : "Focus"
Woven fabric with knitted scrim
Colour : Purple
Nominal Composition : 100% Polyester
Nominal Mass per Unit Area/Density : 380g/m2

AS/NZS 3837-1998 Method of Test for Heat and Smoke Release Rates for Materials and Products using an Oxygen Consumption Calorimeter

	Specimen				
	1	2	3	Mean	
Average Heat Release Rate	39.3	39.0	37.1	38.5	kW/m ²
Average Specific extinction area	84.4	71.7	81.1	79.1	m ² /kg

(according to Specification C1.10 of the Building Code of Australia)

Test orientation : Horizontal

	Specimen				
	1	2	3	Mean	
Irradiance	50	50	50	50	kW/m ²
Exhaust flow rate	24	24	24	24	L/sec
Time to sustained flaming	66	55	68	63	sec
Test duration	311	320	340	324	sec
Peak heat release after ignition	129.6	98.8	123.8	117.4	kW/m ²
Average heat at 60 s	85.0	71.8	90.6	82.5	kW/m ²
Average heat at 180 s	47.9	50.2	48.7	48.9	kW/m ²
Average heat at 300 s	39.6	39.3	37.4	38.8	kW/m ²
Total heat released	9.6	10.3	10.1	10.0	MJ/m ²
Average effective heat of combustion	6.4	6.6	6.4	6.4	MJ/kg

47198

16415

Page 1 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.
AWTA

Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499

TEST REPORT

Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100

Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016

Initial thickness	7.0	7.0	7.0	7.0	mm
Initial mass	86.6	88.1	89.3	88.0	g
Mass remaining	72.6	74.7	75.2	74.2	g
Mass percentage pyrolysed	16.2	15.3	15.8	15.7	%
Mass loss	14.0	13.4	14.1	13.8	g
Average rate of mass loss	6.2	5.9	5.8	6.0	g/m ² .s

These test results relate only to the behaviour of the product under the conditions of the test, they are not intended to be the sole criterion for assessment of performance under real fire conditions.

The results of these fire tests may be used to directly assess fire hazard, but it should be recognised that a single test method will not provide a full assessment of the fire hazard under all fire conditions.

Samples were loose laid onto a substrate of 6mm thick cement sheeting prior to testing.

Tests were conducted with a wire grid placed over the sample during testing. This was done to contain intumescent sample within the sample holder.

47198

16415

Page 2 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.
AWTA
Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499


TEST REPORT

Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100


Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016

Specimen : 1


Heat release rate (kW/m²)

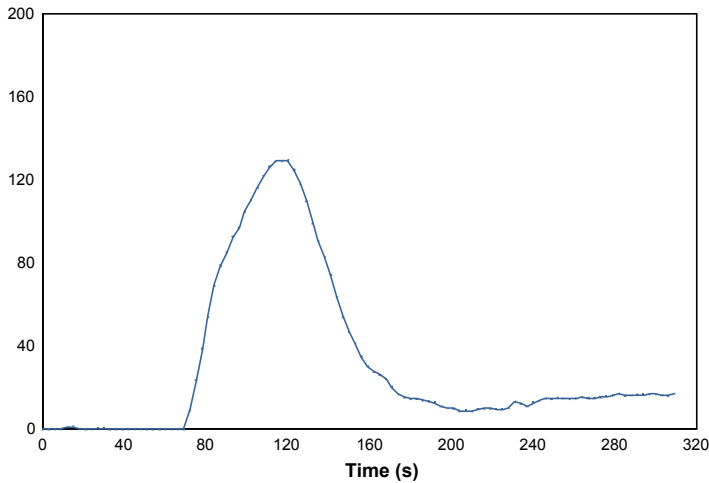


Effective heat of combustion (MJ/kg)

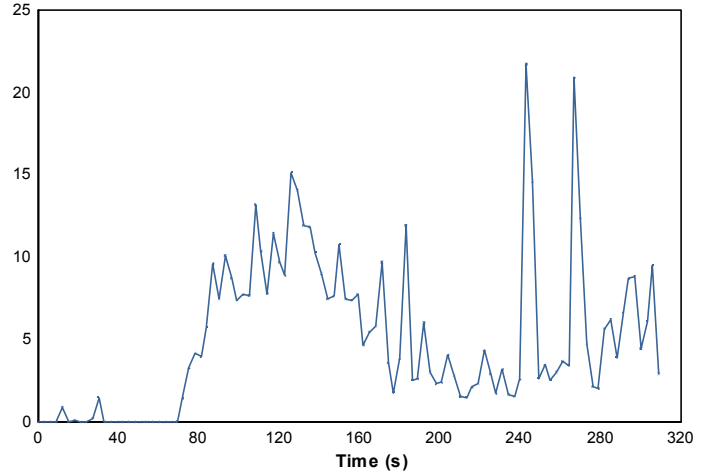

Smoke production rate ([m²/s])

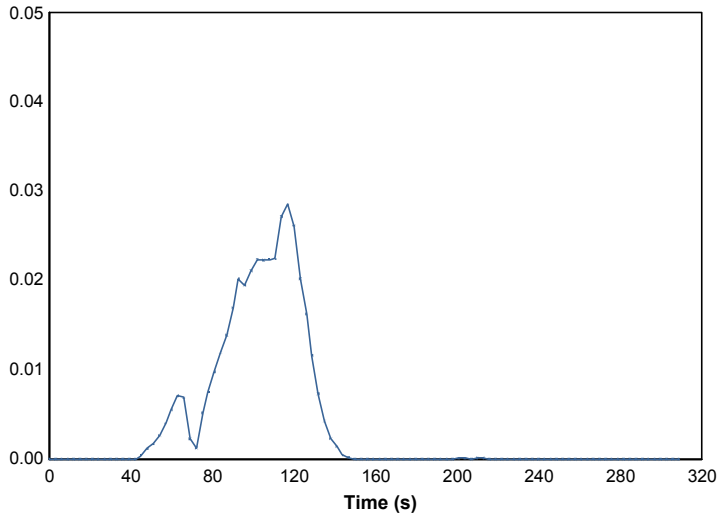

Specific extinction area (m²/kg)

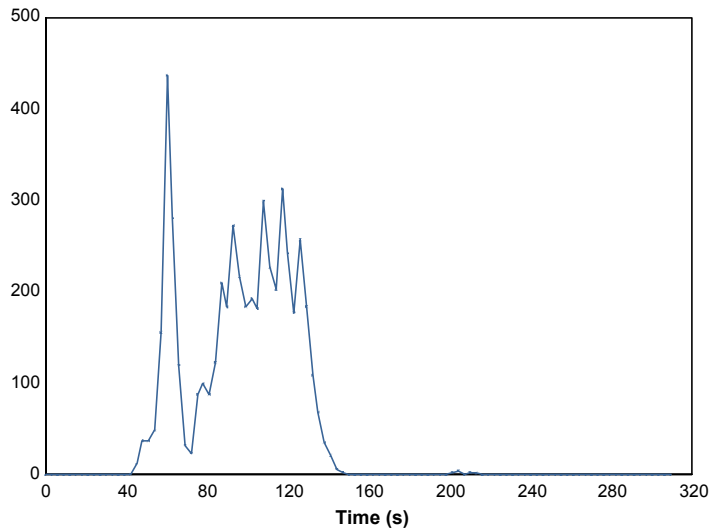

47198

16415

Page 3 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.

AWTA

Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results

relate only to the sample or samples tested. This document shall not be reproduced except in full and

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499

TEST REPORT


Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100

Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016


Mass loss rate (g/s)

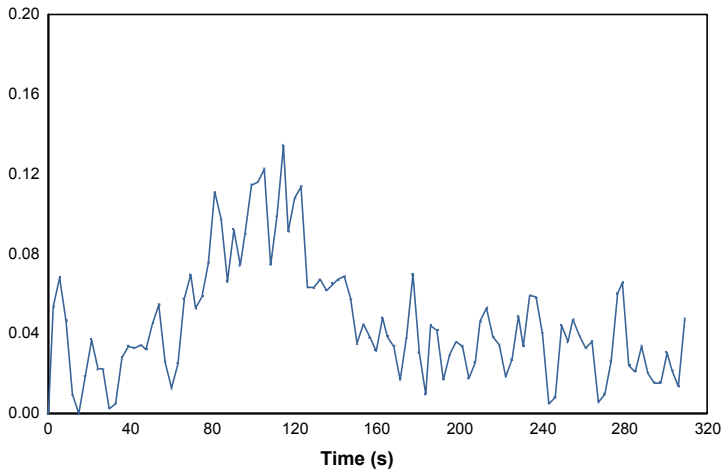


Total heat released (MJ/m²)

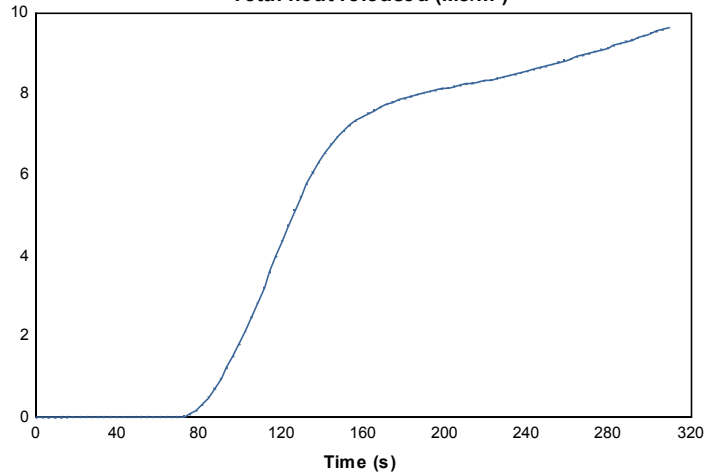

Mass (g)

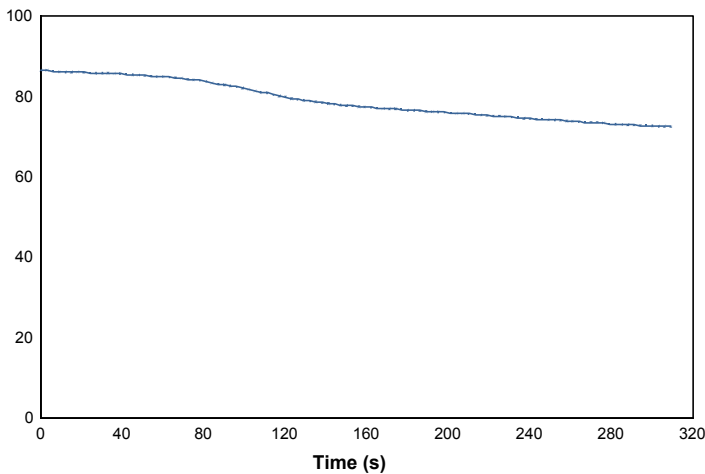

Rate of smoke release ([m²/s)/m²)

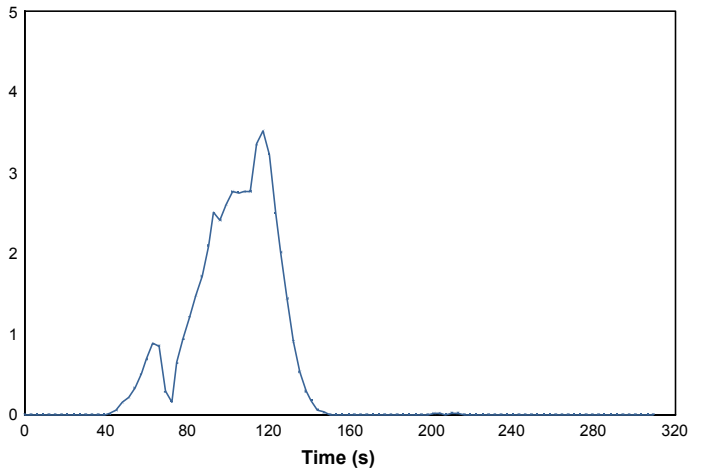

47198

16415

Page 4 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.

AWTA

Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results

relate only to the sample or samples tested. This document shall not be reproduced except in full and

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499


TEST REPORT

Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100


Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016

Specimen : 2


Heat release rate (kW/m²)

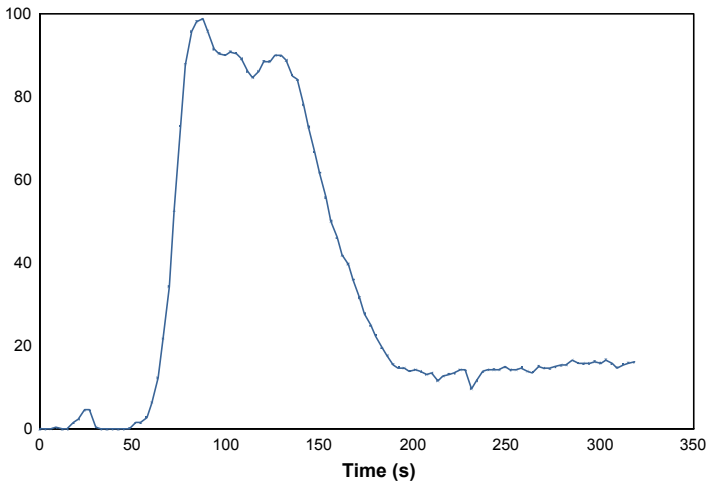


Effective heat of combustion (MJ/kg)

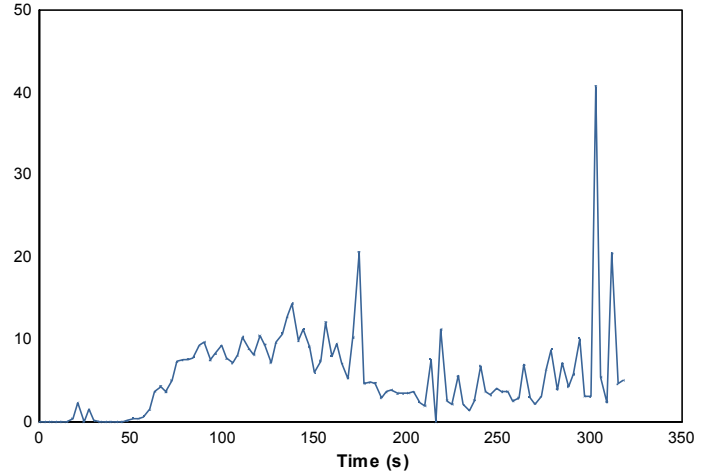

Smoke production rate ([m²/s])

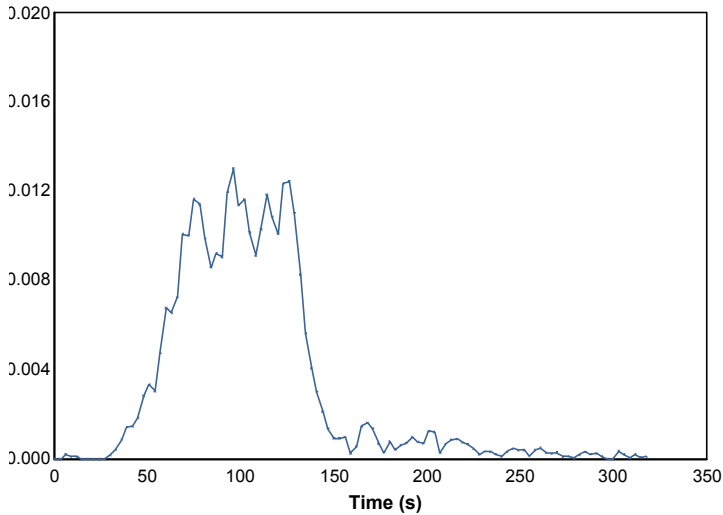

Specific extinction area (m²/kg)

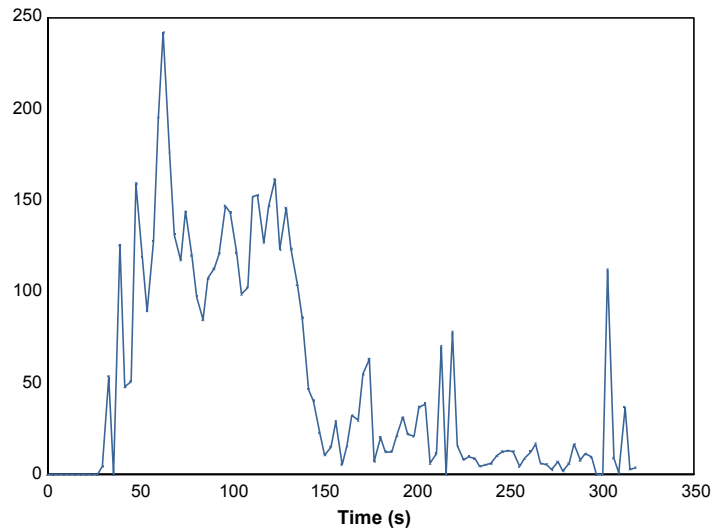

47198

16415

Page 5 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.

AWTA

Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results

relate only to the sample or samples tested. This document shall not be reproduced except in full and

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499

TEST REPORT


Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100

Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016


Mass loss rate (g/s)

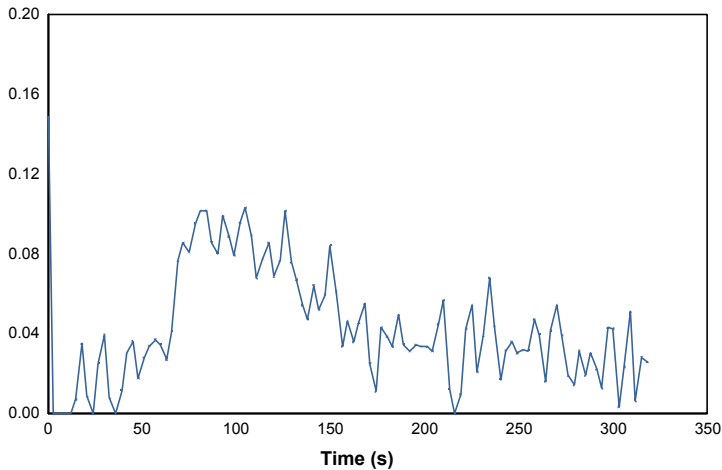


Total heat released (MJ/m²)

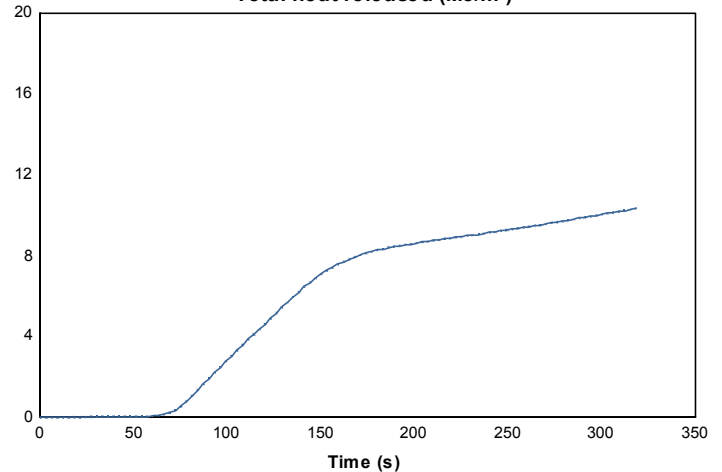

Mass (g)

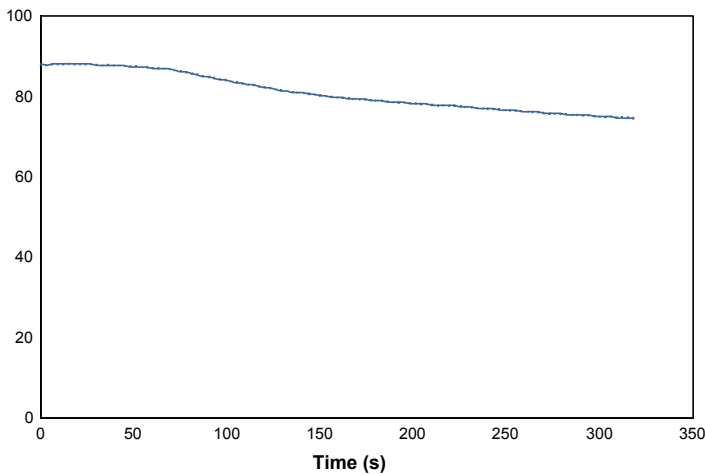

Rate of smoke release ([m²/s]/m²)

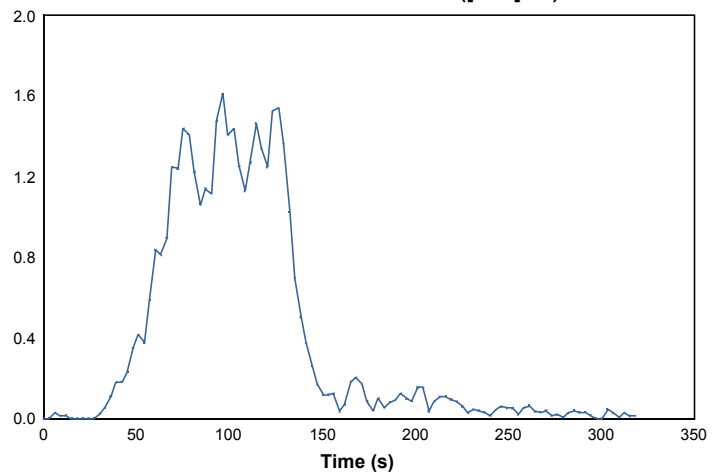

47198

16415

Page 6 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.

AWTA

Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results

relate only to the sample or samples tested. This document shall not be reproduced except in full and

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499


TEST REPORT

Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100


Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016

Specimen : 3


Heat release rate (kW/m²)

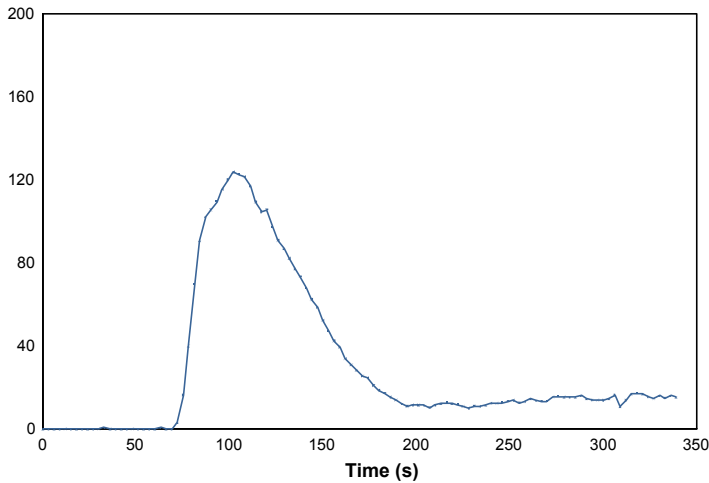


Effective heat of combustion (MJ/kg)

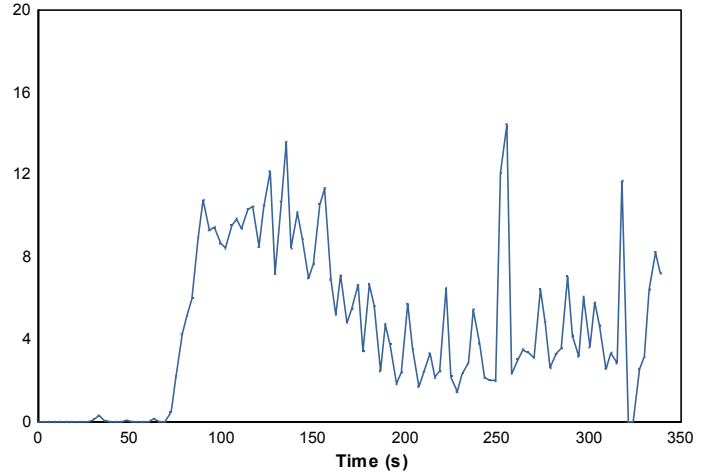

Smoke production rate ([m²/s])

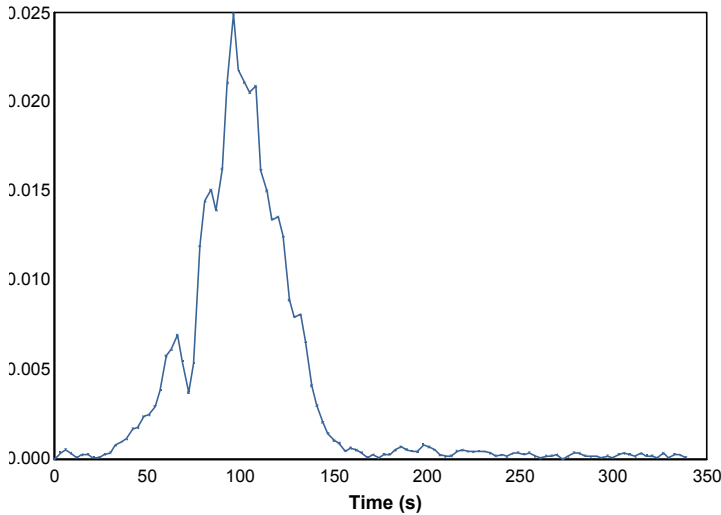

Specific extinction area (m²/kg)

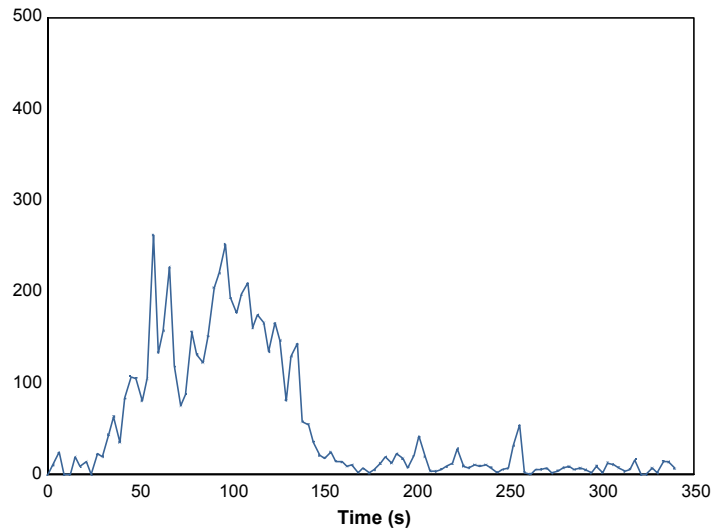

47198

16415

Page 7 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.

AWTA

Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results

relate only to the sample or samples tested. This document shall not be reproduced except in full and

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499

TEST REPORT


Client : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100

Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016


Mass loss rate (g/s)

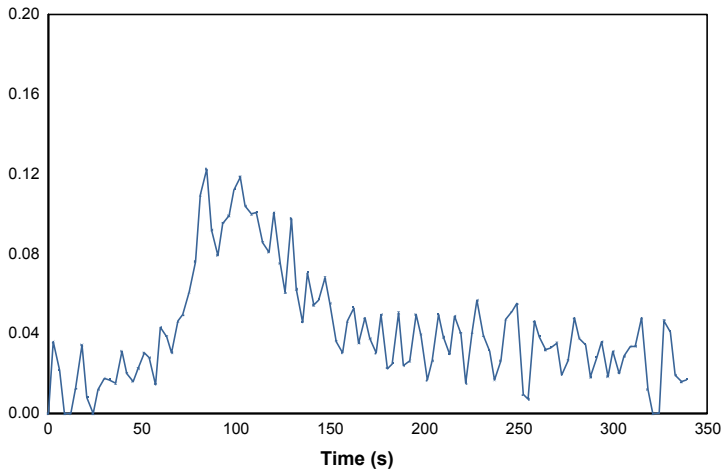


Total heat released (MJ/m²)

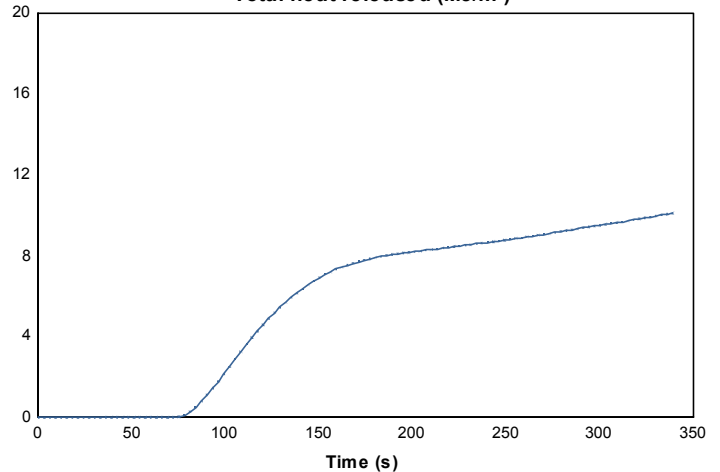

Mass (g)

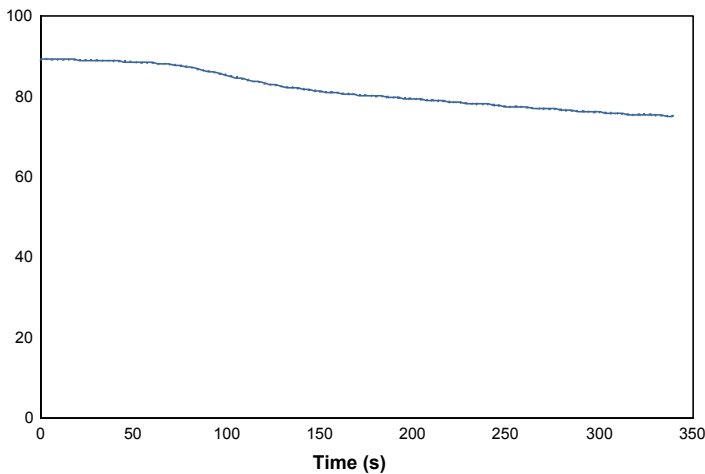

Rate of smoke release ([m²/s]/m²)

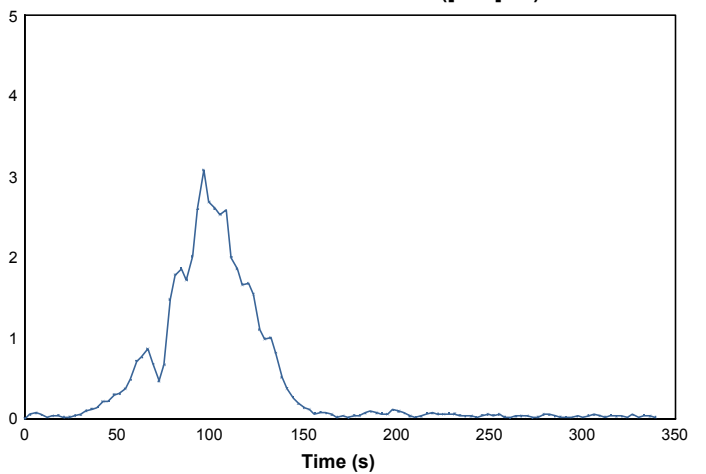

47198

16415

Page 8 of 8

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025
- Chemical Testing
- Mechanical Testing
985

: Accreditation No. 983
: Accreditation No.



Samples and their identifying descriptions have been provided by the client unless otherwise stated.

AWTA

Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results

relate only to the sample or samples tested. This document shall not be reproduced except in full and

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400 Fax (03) 9371 2499

Group Number Assessment

(In accordance with AS 5637.1-2015)

This is to confirm that the product as described below has been tested by AWTA Product Testing .

Testing was performed in accordance with AS/NZS 3837-1998 Method of test for heat and smoke release rates for materials and products using an oxygen consumption calorimeter.

Test Sponsor : Woven Image Pty Ltd
37-39 Chard Road
Brookvale NSW 2100

Test Number : 16-006332
Issue Date : 21/12/2016
Print Date : 22/12/2016

Sponsor Product Clients Ref : "Focus"
Woven fabric with knitted scrim
Colour : Purple
Nominal Composition : 100% Polyester
Nominal Mass per Unit Area/Density : 380g/m²

Product Group Number Classification : 1
Average Specific Extinction Area : 79.1 m²/kg



Chris Campbell
Client Relations Manager

16415

The message/document(s) contained in this electronic attachment is intended for the party to which it is addressed and may contain confidential information or be subject to professional privilege. It's transmission is not intended to place the contents into the public domain.

If you have received this transmission in error, it's disclosure or copying is prohibited . Please contact us by collect call so that arrangements can be made at our expense to rectify the error.