

## Test Report

No. SDFS2311007629FF

Date: Jan.02, 2024

Page 1 of 6

## WOVEN IMAGE INTERIOR MATERIAL (SHANGHAI) CO., LTD.

ROOM 103, BDG B, NO. 3039 LIYUE ROAD, PUJIANG TOWN, MINHANG DIST, SHANGHAI, CHINA

**Sample Description:** ECHOPANEL 12MM**Thickness:** 12mm**Composition:** 100% PET ( 80% RECYCLED)**Density:** 2400GSM**Product usage:** INTERIOR DECORATION

The above data and information was / were submitted and identified on behalf of the client. SGS is not responsible for the authenticity, integrity and results of the data and information and / or the validity of the conclusion.

\*\*\*\*\*

The report is English version of Chinese test report SDFS2311007629FF\_CN. The Chinese version shall prevail in case of discrepancy between the Chinese version and English version.

**Sample Receiving Date:** Dec.01, 2023**Test Performing Date:** Dec.01, 2023 to Jan.02, 2024**Test Requested:**

GB 8624-2012 Fire classification for burning behavior of building materials and products

Clause 5.1.1 Table 2 Classes of reaction to fire performance for slab building materials and construction products

**Test Results:** -- See attached sheet --**Conclusion:** According to the test result, Combustion properties identified as: GB 8624 B<sub>1</sub> (B-s1,d0,t1)

Signed for and on behalf of  
Shunde Branch  
SGS-CSTC Co., Ltd.



Scan to see the report

SDFS2311007629FF  
Verification:  
check.sgsonline.com.cn

Ivette Zhang  
Approved signatory



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

1-2/F, Building 1, European Industrial Park, No.1, Shunhe South Road, Wusha, Daliang, Shunde District, Foshan, Guangdong, China 528300  
中国·广东·佛山市顺德区大良街道办事处五沙社区居民委员会顺和南路1号欧洲工业园一号厂房首层、二层 邮编: 528300

t (86-757) 22805888 [www.sgsgroup.com.cn](http://www.sgsgroup.com.cn)  
t (86-757) 22805888 [sgs.china@sgs.com](mailto:sgs.china@sgs.com)

## Test Report

No. SDFS2311007629FF

Date: Jan.02, 2024

Page 2 of 6

## I. Test Conducted

GB 8624-2012 Fire classification for burning behavior of building materials and products.

Clause 5.1.1 Table 2 Classes of reaction to fire performance for slab building materials and construction products. And the test methods as following:

1. GB/T 20284-2006 Single burning item test for building materials and products;
2. GB/T 8626-2007 Test method of flammability for building materials;
3. GB/T 20285-2006 Toxic classification of fire effluents hazard for materials.

## II. Sample Description

Density	2.40kg/m <sup>2</sup>
Thickness	12mm
Construction	Single layer material structure
Exposed surface	One surface

**Mounting and fixing (For GB/T 20284):**

Test substrate was calcium silicate board meets the requirement of the standard, the density of 900 kg/m<sup>3</sup> and thickness of 10mm.

Specimen was installed on the substrate by screw. There was no joint between specimens. Specimen had a ventilated cavity of 80mm away from the backing board.

## III. Test Results:

Test method	Parameter	Number of tests	Results
GB/T 20284-2006	FIGRA <sub>0.2MJ</sub> (W/s)	3	46.1
	FIGRA <sub>0.4MJ</sub> (W/s)		46.1
	LFS< edge of specimen (Yes/No)		Yes
	THR <sub>600s</sub> (MJ)		5.4
	SMOGRA (m <sup>2</sup> /s <sup>2</sup> )		8.7
	TSP <sub>600s</sub> (m <sup>2</sup> )		38.6
	Flaming particles or droplets within 600s (Yes/No); Combustion time, if any burning time: (≤10s / >10s)		No
GB/T 8626-2007 Exposure = 30 s	Whether vertical flame spread (Fs) in excess of 150 mm within 60s (Yes/No)	12	No
	Ignition of the filter paper within 60s(Yes/No)		No



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

SGS-CSI Standards Technical Services (Shunde) Co., Ltd.  
Shunde Branch / 顺德分公司

1-2/F, Building 1, European Industrial Park, No.1, Shunhe South Road, Wusha, Daliang, Shunde District, Foshan, Guangdong, China 528300  
中国·广东·佛山市顺德区大良街道办事处五沙社区居民委员会顺和南路1号欧洲工业园一号厂房首层、二层 邮编: 528300

t (86-757) 22805888 www.sgsgroup.com.cn  
t (86-757) 22805888 sgs.china@sgs.com

GB/T 20285-2006	Quasi safety level (ZA) Smoke density (mg/L)			---	Smoke density: 6.15 mg/L  Smoke toxicity: The samples met the requirement of narcotic and irritants.
	ZA <sub>1</sub>	ZA <sub>2</sub>	ZA <sub>3</sub>		
	≥25.0	≥12.4	≥6.15		
	Narcotic	No testing mice dead during 30min exposure to fire effluents ( Include 1h after exposure)			
	Irritants	During 3 days after the test, the testing mice recovered average weight.			

### Remark:

FIGRA-Fire growth rate index used for classification purposes [W/s]

LFS-Lateral flame spread [m]

THR<sub>600s</sub>-Total heat release within 600 s [MJ]

SMOGRA-Smoke growth rate [m<sup>2</sup>/s<sup>2</sup>]

TSP<sub>600s</sub> – Total smoke production within 600s[m<sup>2</sup>]

### IV. Classification and direct field of application

This classification has been carried out in accordance with GB 8624-2012 Clause 5.1.1 Table 2 Classes of reaction to fire performance for slab building materials and construction products: The classes with their corresponding fire performance are given in Appendix A.

a) The product in relation to its reaction to fire behaviour is classified:

**Reaction to fire classification: GB 8624 B<sub>1</sub> (B-s1, d0, t1)**

b) Field of application

This classification is valid for the following end use applications:

- With all substrates classified as A1 or A2
- With mechanically fixing
- No joint



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

SGS-CS Standards Technical Services (Shunde) Co., Ltd.  
Shunde Branch / 顺德分公司

1-2/F, Building 1, European Industrial Park, No.1, Shunhe South Road, Wusha, Daliang, Shunde District, Foshan, Guangdong, China 528300  
中国·广东·佛山市顺德区大良街道办事处五沙社区居民委员会顺和南路1号欧洲工业园一号厂房首层、二层 邮编: 528300

t (86-757) 22805888 www.sgs.com.cn  
t (86-757) 22805888 sgs.china@sgs.com

# Test Report

No. SDFS2311007629FF

Date: Jan.02, 2024

Page 4 of 6

## Appendix A

GB 8624 Table 2 Classes of reaction to fire performance for slab building materials and construction products

Class		Test method(s)		Classification criteria
A	A1	GB/T 5464 <sup>a</sup> and		$\Delta T\leq 30^{\circ}\text{C}$ ; $\Delta m\leq 50\%$ ; $t_{\text{f}}=0$
		GB/T 14402		$\text{PCS}\leq 2.0\text{MJ/kg}$ <sup>a, b, c, e</sup> ; $\text{PCS}\leq 1.4\text{MJ/m}^2$ <sup>d</sup>
	A2	GB/T 5464 <sup>a</sup> or	and	$\Delta T\leq 50^{\circ}\text{C}$ ; $\Delta m\leq 50\%$ ; $t_{\text{f}}\leq 20\text{ s}$
		GB/T 14402		$\text{PCS}\leq 3.0\text{MJ/kg}$ <sup>a, e</sup> ; $\text{PCS}\leq 4.0\text{MJ/m}^2$ <sup>b, d</sup>
		GB/T 20284		$\text{FIGRA}_{0.2\text{MJ}}\leq 120\text{W/s}$ ; LFS< edge of specimen; $\text{THR}_{600\text{s}}\leq 7.5\text{ MJ}$
B <sub>1</sub>	B	GB/T 20284 and		$\text{FIGRA}_{0.2\text{MJ}}\leq 120\text{W/s}$ ; LFS< edge of specimen; $\text{THR}_{600\text{s}}\leq 7.5\text{MJ}$
		GB/T 8626 Exposure =30s		$\text{Fs}\leq 150\text{mm}$ within 60s; No ignition of paper within 60s
	C	GB/T 20284 and		$\text{FIGRA}_{0.4\text{MJ}}\leq 250\text{W/s}$ ; LFS< edge of specimen; $\text{THR}_{600\text{s}}\leq 15\text{MJ}$
		GB/T 8626 Exposure=30s		$\text{Fs}\leq 150\text{mm}$ within 60 s; No ignition of paper within 60s
B <sub>2</sub>	D	GB/T 20284 and		$\text{FIGRA}_{0.4\text{MJ}}\leq 750\text{W/s}$
		GB/T 8626 Exposure=30s		$\text{Fs}\leq 150\text{mm}$ within 60 s; No ignition of paper within 60s
	E	GB/T 8626 Exposure =15s		$\text{Fs}\leq 150\text{mm}$ within 20 s; No ignition of paper within 20s
B <sub>3</sub>	F	No performance determined		



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

1-2/F, Building 1, European Industrial Park, No.1, Shunhe South Road, Wusha, Daliang, Shunde District, Foshan, Guangdong, China 528300

t (86-757) 22805888

[www.sgsgroup.com.cn](http://www.sgsgroup.com.cn)

中国·广东·佛山市顺德区大良街道办事处五沙社区居民委员会顺和南路1号欧洲工业园一号厂房首层、二层 邮编: 528300

t (86-757) 22805888

[sgs.china@sgs.com](mailto:sgs.china@sgs.com)



# Test Report

No. SDFS2311007629FF

Date: Jan.02, 2024

Page 5 of 6

Class	Test method(s)	Classification criteria
<sup>a</sup> For homogeneous products or substantial components of non-homogeneous products. <sup>b</sup> For any external non-substantial component of non-homogeneous products. <sup>c</sup> any external non-substantial component having a PCS $\leq 2.0 \text{ MJ/m}^2$ , provided that the product satisfies the following criteria of FIGRA <sub>0.2MJ</sub> $\leq 20 \text{ W/s}$ , and LFS < edge of specimen, and THR <sub>600s</sub> $\leq 4.0 \text{ MJ}$ , and s1, and d0 can be defined A1. <sup>d</sup> For any internal non-substantial component of non-homogeneous products. <sup>e</sup> For the product as a whole.		
Insulation foam metope, in addition to comply with stipulated in table 2 shall be at the same time satisfy the following requirements: B <sub>1</sub> level oxygen index (OI 30% or higher; B <sub>2</sub> level oxygen index (OI 26% or higher)		

GB 8624 Table B.1 smoke production levels and grading criterion

SMOGRA	Test Method	Requirement
s1	GB/T 20284	$\text{SMOGRA} \leq 30\text{m}^2/\text{s}^2$ ; $\text{TSP}_{600\text{s}} \leq 50\text{m}^2$
s2		$\text{SMOGRA} \leq 180\text{m}^2/\text{s}^2$ ; $\text{TSP}_{600\text{s}} \leq 200\text{m}^2$
s3		not s1 or s2

GB 8624 Table B.2 Burning droplets / particles grades and grading criterion

Burning droplets / particles grades	Test Method	Requirement
d0	GB/T 20284	No flaming droplets/ particles within 600 s
d1		Flaming droplets/ particles persisting longer than 10 s within 600 s
d2		not d0 or d1

GB 8624 Table B.3 smoke toxicity levels and grading criterion

Toxicity	Test Method	Requirement
t0	GB/T 20285	Achieve quasi-safety level 1 ZA <sub>1</sub>
t1		Achieve quasi-safety level 3 ZA <sub>3</sub>
t2		Failure to reach quasi-safe Level 3 ZA <sub>3</sub>



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

SGS-CS Standards Technical Services Co., Ltd.  
Shunde Branch

1-2/F, Building 1, European Industrial Park, No.1, Shunhe South Road, Wusha, Daliang, Shunde District, Foshan, Guangdong, China 528300  
中国·广东·佛山市顺德区大良街道办事处五沙社区居民委员会顺和南路1号欧洲工业园一号厂房首层、二层 邮编: 528300

t (86-757) 22805888 www.sgsgroup.com.cn  
t (86-757) 22805888 sgs.china@sgs.com

## Test Report

No. SDFS2311007629FF

Date: Jan.02, 2024


Page 6 of 6

### Statement:

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

Note: This document cannot be reproduced except full, without prior written approval of the Company.

### Photo Appendix:

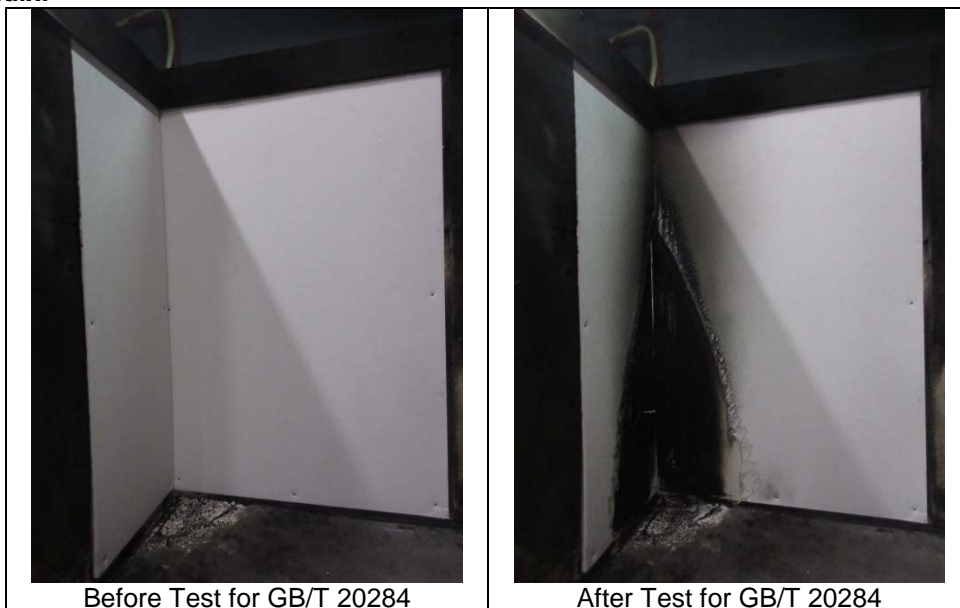

Test sample for GB/T 20285

**Remark:** GB/T 20285-2006 is not within CNAS accreditation testing scope of the lab. This test was subcontracted to Guangzhou Building Materials Institute Limited Company whose registration No. is CNAS L0057 and accreditation testing scope contains this test item.

\*\*\*End of Report\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

SGS-CS 标准技术服务有限公司  
Shunde Branch / 顺德分公司

1-2/F, Building 1, European Industrial Park, No.1, Shunhe South Road, Wusha, Daliang, Shunde District, Foshan, Guangdong, China 528300  
中国·广东·佛山市顺德区大良街道办事处五沙社区居民委员会顺和南路1号欧洲工业园一号厂房首层、二层 邮编: 528300

t (86-757) 22805888 www.sgs.com.cn  
t (86-757) 22805888 sgs.china@sgs.com